

Patient reference: MKD639473
Patient name: Mohammed, Mansoor
Date of birth: n/a
Gender: Male
Gestational age: n/a
Keywords:

Clinic ref:
Site: Al Baraha Audiology
Examiner: GSI
Exam date: 1/26/2022 4:09 PM
Age on exam date: n/a

Result summary^{F1}

Result	Score
T1Left DPgram	REFER
T2Right DPgram	REFER

F2

Chart 1 -- Trials

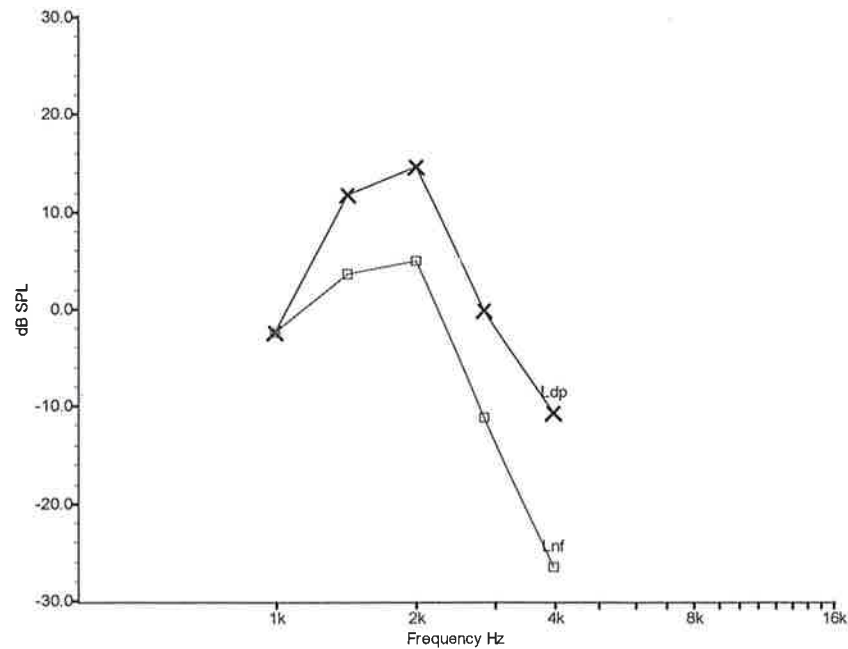


Chart 1 -- Trial details

Trace	Ear	Test type	F1 Level	F2 Level	Freq Is	Test Freq	F2/F1
T1Left DPgram	Left	DPgram	65.0 dB SPL	55.0 dB SPL	F2	996.1 Hz	1.21
T1Left DPgram	Left	DPgram	65.0 dB SPL	55.0 dB SPL	F2	1418.0 Hz	1.22
T1Left DPgram	Left	DPgram	65.0 dB SPL	55.0 dB SPL	F2	2003.9 Hz	1.22
T1Left DPgram	Left	DPgram	65.0 dB SPL	55.0 dB SPL	F2	2824.2 Hz	1.22
T1Left DPgram	Left	DPgram	65.0 dB SPL	55.0 dB SPL	F2	3996.1 Hz	1.22

Left preserved OAE
D.M.

Chart 1 -- Trial details

Trace	F1 Freq	F2 Freq	DP Freq	DP S/N	DP	Noise
T1Left DPgram	820.3 Hz	996.1 Hz	644.5 Hz			-2.4 dB SPL
T1Left DPgram	1160.2 Hz	1418.0 Hz	902.3 Hz	8.1 dB	11.7 dB SPL	3.6 dB SPL
T1Left DPgram	1640.6 Hz	2003.9 Hz	1277.3 Hz	9.5 dB	14.6 dB SPL	5.0 dB SPL
T1Left DPgram	2320.3 Hz	2824.2 Hz	1816.4 Hz	11.0 dB	-0.1 dB SPL	-11.1 dB SPL
T1Left DPgram	3281.3 Hz	3996.1 Hz	2566.4 Hz	15.9 dB	-10.7 dB SPL	-26.6 dB SPL

Chart 2 -- Trials

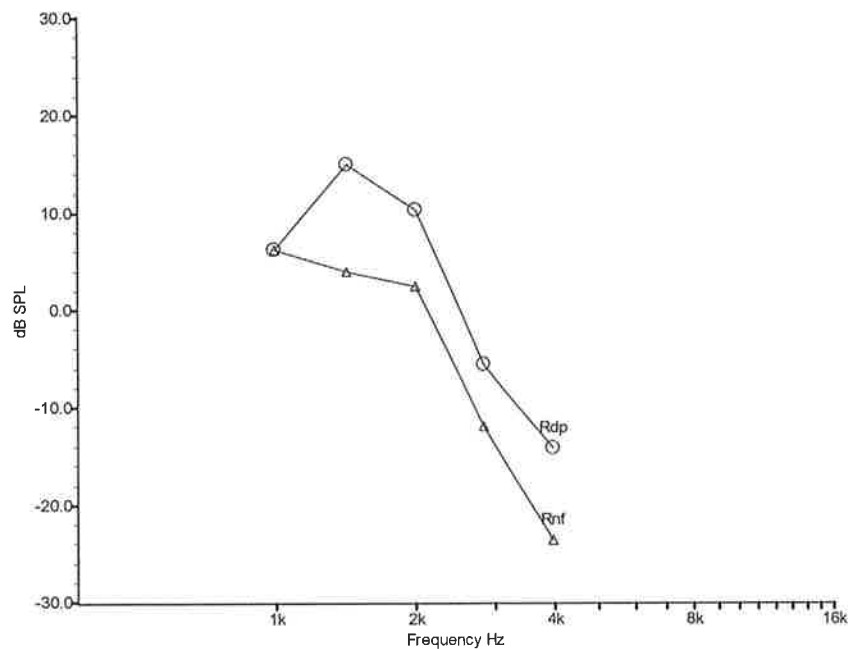


Chart 2 -- Trial details

Trace	Ear	Test type	F1 Level	F2 Level	Freq Is	Test Freq	F2/F1
T2Right DPgram	Right	DPgram	65.0 dB SPL	55.0 dB SPL	F2	996.1 Hz	1.21
T2Right DPgram	Right	DPgram	65.0 dB SPL	55.0 dB SPL	F2	1418.0 Hz	1.22
T2Right DPgram	Right	DPgram	65.0 dB SPL	55.0 dB SPL	F2	2003.9 Hz	1.22
T2Right DPgram	Right	DPgram	65.0 dB SPL	55.0 dB SPL	F2	2824.2 Hz	1.22
T2Right DPgram	Right	DPgram	65.0 dB SPL	55.0 dB SPL	F2	3996.1 Hz	1.22

Trace	F1 Freq	F2 Freq	DP Freq	DP S/N	DP	Noise
T2Right DPgram	820.3 Hz	996.1 Hz	644.5 Hz			6.2 dB SPL
T2Right DPgram	1160.2 Hz	1418.0 Hz	902.3 Hz	10.9 dB	14.9 dB SPL	4.0 dB SPL
T2Right DPgram	1640.6 Hz	2003.9 Hz	1277.3 Hz	7.7 dB	10.2 dB SPL	2.4 dB SPL
T2Right DPgram	2320.3 Hz	2824.2 Hz	1816.4 Hz	6.4 dB	-5.6 dB SPL	-12.0 dB SPL
T2Right DPgram	3281.3 Hz	3996.1 Hz	2566.4 Hz	9.4 dB	-14.2 dB SPL	-23.6 dB SPL

Rt preserved OAE
D. Mansoor

Chart 2 -- Trial details

